
Anchorage Water and Wastewater Utility

Anchorage: Performance. Value. Results.

Mission

Supporting the public health, safety, and economic interests of the community by providing quality water and wastewater services in a responsible, efficient, and sustainable manner.

Core Services

- Reliably treat and distribute potable water for domestic, commercial, and firefighting uses throughout the certificated service area.
- Reliably collect, treat and dispose of wastewater in accordance with laws and regulations that protect public health and the environment.

Accomplishment Goals

- Provide reliable service
- Provide safe drinking water that meets or exceeds all standards
- Protect the environment through appropriate wastewater collection, treatment, and disposal.
- Fiscal responsibility and transparency with utility finances.
- Timely, professional, and courteous interactions with customers.
- Rates that fairly reflect the cost of providing service and maintaining infrastructure
- Continuous improvement in the efficiency of our operations
- Anticipate change and be prepared for the future.

Performance Measures

Progress in achieving goals shall be measured by:

1. Compliance with all State and Federal drinking water standards
/wastewater standards
/Clean Air Act standards
2. Number of planned and unplanned water outages
3. Sanitary sewer overflows
4. Recordable incident rate (as compared to the standard incident rate for water and wastewater utilities)
5. Execution of capital improvement budget
6. Debt to equity ratio

Measure #1: Compliance with all State and Federal drinking water, wastewater, and clean air standards

Compliance with all State and Federal drinking water, wastewater, and clean air standards	Goal	2 nd Q 2013	Historical Information			
			1 st Q 2013	2012 Annual	2011 Annual	2010 Annual
Safe Drinking Water Act Compliance	100%	100%	100%	100%	100%	100%
Clean Water Act (NPDES permit) Compliance	100%				100%	99.99%
-Asplund		100%	100%	100%		
-Eagle River		100%	100%	99.5%		
-Girdwood		100%	100%	97.5%		
Clean Air Act Compliance (Asplund Incinerator)	100%	100%	99.99%	99.99%	99.99%	99.99%

Measure #2: Number of planned and unplanned water outages

Planned and unplanned water outages (customers per month)	Goal (Affected customers per month)	2 nd Q 2013 (monthly average)	1 st Q 2013 (monthly average)	Historical monthly average			
				2012	2011	2010	2009
Planned Outages							
<4 hours	<20	13	0	18	12	12	107
4-12 hours	<20	47	0.7	47	23	28	96
>12 hours	0	0	0	0.2	0.1	0.2	27
Unplanned Outages							
<4 hours	<20	32	9	46	23	30	27
4-12 hours	<50	36	21	38	51	50	59
>12 hours	0	5	13	4	9	3	15

Measure #3: Sanitary Sewer Overflows


	Goal	2 nd Q 2013 (per month)	1 st Q 2013 (per month)	Historical monthly average				
				2012	2011	2010	2009	2008
Sanitary Sewer Overflows (monthly)	<1.5	1.33	2.33	1.83	1.91	1.33	1.58	1

Measure #4: Number of reportable injuries and accidents

	Goal		Historical Information				
			2012	2011	2010	2009	2008
Number of reportable injuries and accidents (annual)	<4.60	5.2	4.4	1.72	4.10	4.00	

Measure #5: Execution of Capital Improvement Budget

	Goal	2012	Historical Information			
			2011	2010	2009	2008
Execution of Capital Improvement Budget (annual)	75%	65%	61%	66%	129%	67%

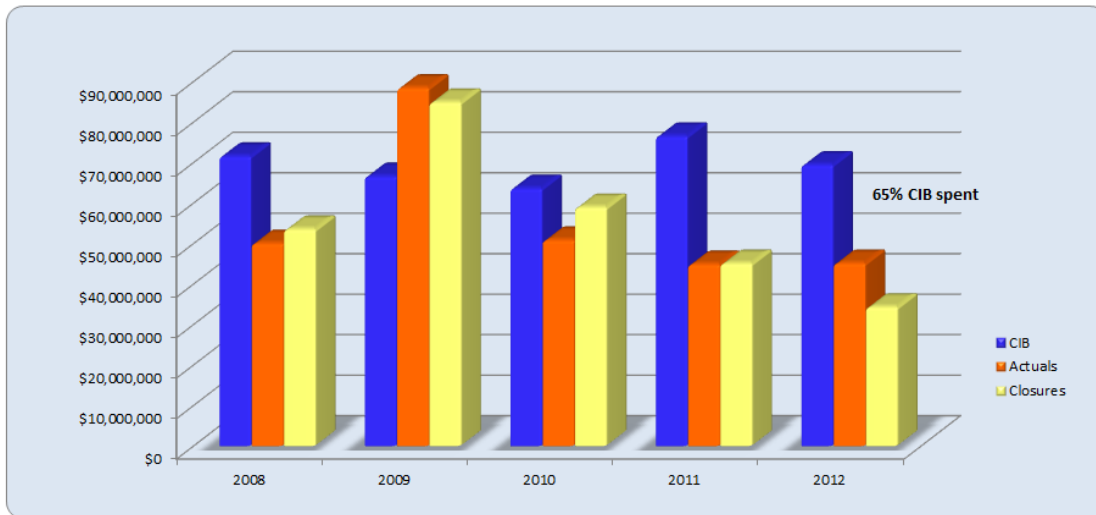

Measure #6: Debt to Equity Ratio

	Goal	2012	Historical Information			
			2011	2010	2009	2008
Debt to Equity Ratio (annual)						
Water Utility	67/33	67/33	70/30	70/30	71/29	72/28
Wastewater Utility	67/33	66/34	68/32	69/31	68/32	66/34

Performance Measure Methodology Sheet
Anchorage Water and Wastewater Utility

Measure #1: Compliance with all State and Federal drinking water, wastewater, and clean air standards,

Type

Effectiveness

Accomplishment Goals Supported

- Provide reliable service
- Provide safe drinking water that meets or exceeds all standards
- Protect the environment through appropriate wastewater collection, treatment, and disposal.

Definition

Number of required regulatory measurements indicating conditions are out of compliance with current standards, divided by total number of required regulatory compliance points for the time period. If measurements are taken daily, but the data are averaged for comparison to a standard on a weekly basis, only the weekly report constitutes a compliance point. If separate standards exist for monthly and weekly averages, they are distinct compliance points.

Data Collection Method

All samples collected are compared with the State or Federal regulatory standards and any violations are noted and reported in accordance with permit stipulations.

Frequency

The percent compliance measurement will be calculated quarterly, using running totals for the calendar year.

Measured By

The Treatment Division will prepare a report from the water quality and laboratory databases that identifies any samples or reportable incidents that do not meet regulatory standards.

Reporting

The Treatment Division Director will update the report quarterly from the water quality and laboratory databases. The information will be displayed in tabular form.

Used By

The Treatment Division Director and General Manager will use the information to gain a clearer understanding of performance of AWWU's treatment facilities and determine if changes in system operation or maintenance are required.

Performance Measure Methodology Sheet
Anchorage Water and Wastewater Utility

Measure #2: Number of planned and unplanned water outages
--

Type

Effectiveness

Accomplishment Goal Supported

- Provide reliable service
- Provide safe drinking water that meets or exceeds all standards
- Protect the environment through appropriate wastewater collection, treatment, and disposal.
- Timely, professional, and courteous interactions with customers.
- Continuous improvement in the efficiency of our operations
- Anticipate change and be prepared for the future

Definition

A water outage is defined as a disruption in service to a service connection. A service connection serves one customer, although multiple people may be affected by the disruption in service to a residence or a business.

Data Collection Method

A tally is kept through each calendar month of the number of customers who experience planned and unplanned water service disruptions for a range of durations listed below. The outage is as reported to AWWU and confirmed by observation or analysis in the field.

Frequency

The measurement will be recorded at the beginning of each month for the preceding month.

Measured By

Number of customers who do not have water service for the following durations:

- Less than 4 hours
- Between 4 hours and 12 hours
- Greater than 12 hours

Disruptions are counted for planned activities (customers are given advance notice in writing) and unplanned (emergency) activities.

Reporting

The Strategic Asset Services Section will create a monthly report that will be show water outages numerically and graphically.

Used By

The O&M Division, Customer Service Division, and Strategic Asset Services Section and the General Manager will review these data monthly to evaluate adequacy of operation and maintenance approaches, customer service response and pipe condition.

Performance Measure Methodology Sheet
Anchorage Water and Wastewater Utility

Measure #3: Sanitary Sewer Overflows

Type

Effectiveness

Accomplishment Goals Supported

- Provide reliable service.
- Timely, professional, and courteous interactions with customers.
- Protect the environment through appropriate wastewater collection, treatment, and disposal.
- Continuous improvement in the efficiency of our operations
- Anticipate change and be prepared for the future.

Definition

Total number of wastewater overflows onto the ground or wastewater back-ups into customer residences if caused by an obstruction in an AWWU sewer main, manhole, or cleanout. Overflows or backups that occur due to on-property blockages do not count.

Data Collection Method

The reportable number of sanitary sewer overflows is what is reported in writing to the EPA Region X office within a week of each occurrence.

Frequency

The measurement will be recorded each month for the previous month.

Measured By

Data collection is by direct observation by AWWU staff.

Reporting

The O&M Division will create a monthly report displaying overflow data numerically and graphically.

Used By

The O&M Division, Customer Service Division, and Strategic Asset Services Section and the General Manager will review these data monthly to evaluate adequacy of operation and maintenance approaches, customer service response and pipe condition.

Performance Measure Methodology Sheet
Anchorage Water and Wastewater Utility

Measure #4: Number of reportable injuries and accidents
--

Type

Effectiveness

Accomplishment Goal Supported

- Provide reliable service
- Continuous improvement in the efficiency of our operations
- Anticipate change and be prepared for the future.

Definition

Number of OSHA recordable incidents multiplied by 200,000 (# defined by OSHA as 100 employees working full-time for a year) divided by number of hours worked by all employees. Compare Recordable incident rate to standard industrial rate (SIR) for water and wastewater utilities.

Data Collection Method

Accident and near-miss reports

Frequency

Beginning of each month

Measured By

Safety Program Manager, Employee Services Division.

Reporting

The Employee Services Division will maintain an accident and near miss report on a monthly basis. Data will be compiled, summarized, and reported annually.

Used By

The Safety Manager, all Division Directors and the General Manager will use the report to monitor and adjust working practices and focus training and attention to hazardous situations.

Performance Measure Methodology Sheet
Anchorage Water and Wastewater Utility

Measure #5: Execution of Capital Improvement Budget
--

Type

Efficiency

Accomplishment Goal Supported

- Provide reliable service
- Fiscal responsibility and transparency with utility finances.
- Rates that fairly reflect the cost of providing service and maintaining infrastructure
- Continuous improvement in the efficiency of our operations
- Anticipate change and be prepared for the future.

Definition

The ratio (as a percent) of capital project dollars expended through the fiscal year divided by the planned expenditure for the year as indicated in the approved Capital Improvement Budget.

Data Collection Method

Project Managers input % complete data and expected completion dates for each project named in the capital improvement budget.

Frequency

Estimates of the completeness (% complete) of all ongoing projects will be reported through the AWWU Engineering Division Project Management group annually.

Measured By

The Engineering Division will keep track of this information using the ERP tracking and reporting system.

Reporting

The information will be displayed numerically and graphically in monthly reports.

Used By

The Engineering Director and General Manager will use this data to gauge progress on use of capital project funds.

Performance Measure Methodology Sheet
Anchorage Water and Wastewater Utility

Measure #6: Debt to Equity Ratio

Type

Effectiveness

Accomplishment Goal Supported

- Fiscal responsibility and transparency with utility finances.
- Anticipate change and be prepared for the future.

Definition

The relative percentages of assets are funded by debt and equity, respectively. The total of debt funding and equity funding equals 100%.

Data Collection Method

The calculation is performed by comparing debt and equity to assets annually.

Frequency

The measurement will be calculated annually upon completion of the Utility's audited financial statement.

Measured By

The Finance Division will calculate this ratio from financial statement data.

Reporting

The Finance Division manager will create and maintain an annual report. Trend information will be displayed in a table.

Used By

The information will be used by the Finance Division Director, General Manager, Board and Administration to help evaluate debt financing levels.